Revisions

REV.	DESCRIPTION	DRWN	APPD.	DATE

Issue Table

TO	FOR	DATE

DRAWING TITLE:

RDR HS or LS-1 PCM

PROJECT:

FOR USE WITH PETROVEND CARDLOCKS

RDR

USA - ISSAQUAH (800) 426-0327
CANADA - CALGARY (800) 661-6154

DRAWN BY:	JM
DATE DRAWN:	Apr 12/10
DRAWING SCALE:	
CHECKED BY:	
APPROVED BY:	JB
CLIENT FILE No.	
CAD FILE No.	
PLOT SCALE	
PLOT DATE	
PLOT PARAMETERS	
DRAWING No.	HS or LS-1 PCM

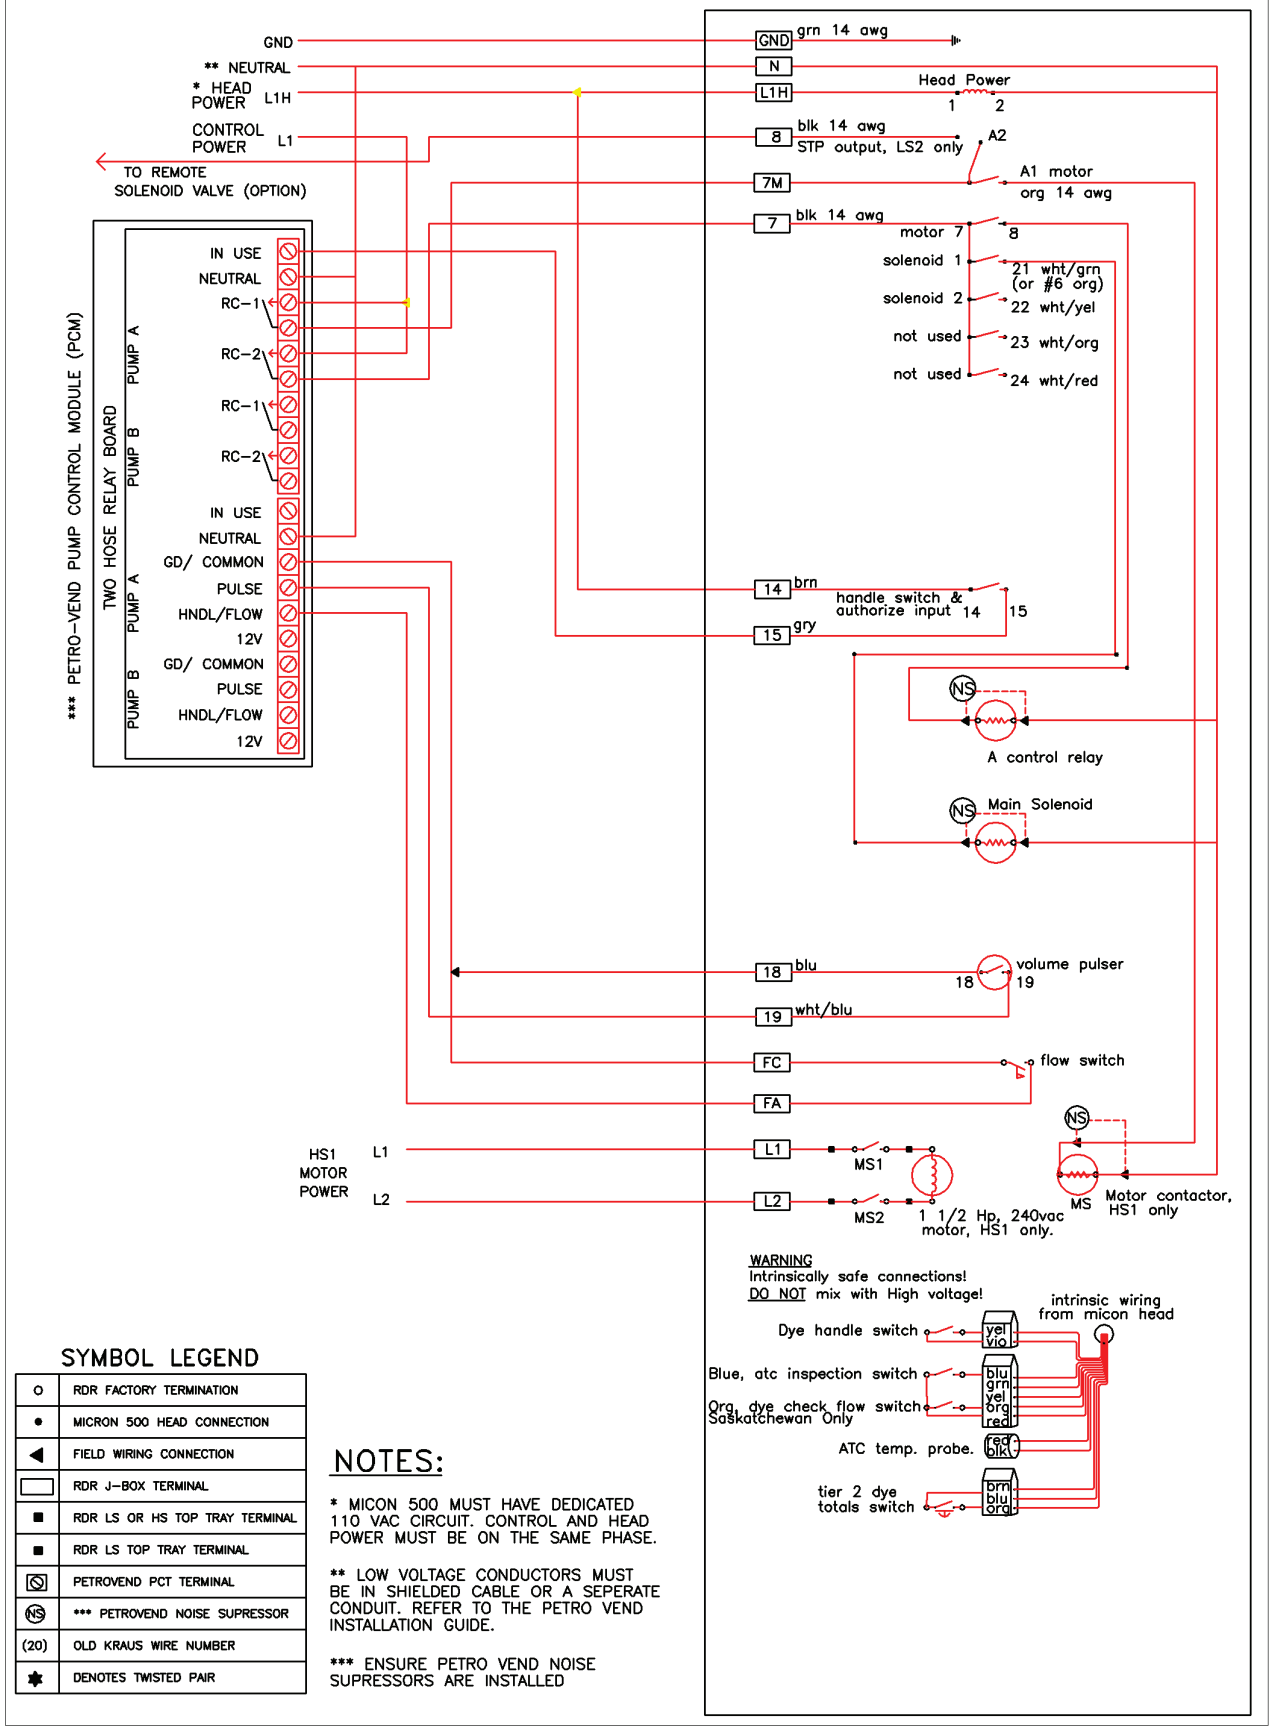

SYMBOL LEGEND

o	RDR FACTORY TERMINATION
•	MICRON 500 HEAD CONNECTION
◀	FIELD WIRING CONNECTION
▭	RDR J-BOX TERMINAL
■	RDR LS OR HS TOP TRAY TERMINAL
■	RDR LS TOP TRAY TERMINAL
⊘	PETROVEND PCT TERMINAL
NS	*** PETROVEND NOISE SUPRESSOR
(20)	OLD KRAUS WIRE NUMBER
✸	DENOTES TWISTED PAIR

NOTES:

* MICON 500 MUST HAVE DEDICATED 110 VAC CIRCUIT. CONTROL AND HEAD POWER MUST BE ON THE SAME PHASE.

** LOW VOLTAGE CONDUCTORS MUST BE IN SHIELDED CABLE OR A SEPERATE CONDUIT. REFER TO THE PETRO VEND INSTALLATION GUIDE.

*** ENSURE PETRO VEND NOISE SUPRESSORS ARE INSTALLED